

Use of PCM Enhanced Insulation in the Building Envelope

Jan Kośny, PhD

David W. Yarbrough, PhD, PE

William A. Miller, PhD, PE

Oak Ridge National Laboratory, Oak Ridge, TN

ABSTRACT

Different types of Phase Change Materials (PCMs) have been tested as dynamic components in buildings for at least four decades. Past studies have found that PCMs enhance building energy performance. Some PCM-enhanced building materials, like PCM-gypsum boards or PCM-impregnated concretes have already found their limited applications in different countries. However, problems such as high initial cost and flammability of organic PCMs, or loss of phase-change capability, corrosion, and PCM leakage in the case of inorganic PCMs are still hampering their widespread adoption. Today, continued improvements in building envelope technologies suggest that residences will soon include PCM applications that will contribute to near-zero heating and cooling loads.

Older PCM studies were focused on temperature control in most cases utilized either inorganic PCMs or non-encapsulated paraffinic PCMs. Today, a wide group of macro- and micro- encapsulated PCMs are available thus creating a chance for new applications. A new generation of PCM-enhanced building components could have a high potential for successful adoption in U.S. buildings because of their ability to reduce energy consumption for space conditioning and reduce peak loads. Other anticipated advantages of PCMs are improvement of occupant comfort, compatibility with traditional wood and steel framing technologies, and potential for application in retrofit projects. Most current studies (Feustel 1995, Tomlinson 1992, Kosny 2001) demonstrate that the use of thermal mass in well-insulated buildings can generate heating and cooling energy savings of up to 25% in U.S. residential buildings. PCMs are used in conjunction with low-emittance surfaces, cool-roof coatings, optimized thermal insulations, and ventilated cavities. Current lab and field experiments demonstrated that it is relatively easy to reduce roof and wall cooling loads by 30% to 50%.

INTRODUCTION

PCM-enhanced building materials have been tested for at least 40 years. Many potential PCMs have been considered for building applications, including inorganic salt hydrates, organic fatty acids and eutectic mixtures, fatty alcohols, neopentyl glycol, and paraffinic hydrocarbons. There were several moderately successful attempts in the 1970s and 1980s to use different types of organic and inorganic PCMs to reduce peak loads and heating and cooling energy consumption (Balcomb 1983). Historically, performance investigations focused on impregnating concrete, gypsum, or ceramic masonry with salt hydrates or paraffinic hydrocarbons. Most of these studies found that PCMs improved building energy performance by reducing peak-hour cooling loads and by shifting peak-demand time.

Paraffinic hydrocarbons generally performed well, but they compromised the fire resistance of the building envelope. Kissock et al. (1998) reported that wallboard including a paraffin mixture made up mostly of n-octadecane, which has a mean melting temperature of 24°C (75°F) and a latent heat of fusion of 143 kJ/kg (65 Btu/lb), “was easy to handle and did not possess a waxy or slick surface. It scored and fractured in a manner similar to regular wallboard. Its unpainted color changed from white to gray. The drywall with PCM required no special surface preparation for painting.” In addition, Salyer and Sircar (1989) reported that during tests of 1.22×2.44 m (4×8 ft) wallboard with PCM, there was insignificant loss of PCM after three months of exposure to continuously cycled 37°C (100°F) air.

The capability of PCMs to reduce peak loads is also well documented. For example, Zhang, Medina, and King (2005) found peak cooling load reductions of 35 to 40% in side-by-side testing of conditioned small houses with and without paraffinic PCM inside the walls. Similarly, Kissock et al. (1998) measured peak temperature reductions of up to 10°C (18°F) in side-by-side testing of unconditioned experimental houses with and without paraffinic PCM wallboard. Kosny (2006) reported that PCM-enhanced cellulose insulation can reduce wall-generated peak-hour cooling loads by about 40%.

In the past, PCMs were utilized to control of the internal building temperature. They were installed directly on interior building surfaces. One of the applications investigated at that time was a gypsum board impregnated with paraffin. From the thermal stand point this application was satisfactory. However, one of the main reasons for a relatively low acceptance of that material by the building industry was its relatively high flammability. In the current research, microencapsulated paraffinic PCMs are placed deeper inside the building envelope. Placement in these locations is expected to significantly reduce flammability issues that were common in earlier applications of the technology. Also, detailed optimizations performed for PCM applications showed a significant reduction of initial costs with a corresponding reduction in payback time. Two forms of PCM are tested: PCM dispersed in fiber insulations, and concentrated application of PCM in frame walls and residential attics. The main goal of the described project is experimental validation of several theoretical concepts. This paper presents results from dynamic laboratory testing and small-scale field experiments performed using new types of PCM-enhanced building envelope components.

Testing of Conventional Wood Stud Wall with Dynamic Reflective Insulation Containing PCM-Enhanced Foam

During last decade, numerous wall assemblies containing conventional thermal mass and PCM components have been studied using transient heat conduction simulations. Several new material configurations were developed and theoretically optimized (Kossecka and Kosny 2001; Kosny 2006). Experimental validation has been performed with the use of dynamic hot-box testing. One of the first tested material configurations was gypsum-based stucco containing 20% by weight of microencapsulated PCM. A test wood frame wall containing about 35 lb (15.9 kg) of PCM (in a ¾ in. or 1.9-cm. thick layer of stucco) was constructed and tested in the hot box. This simple dynamic hot-box test, very similar to previous experiments performed on PCM-impregnated gypsum boards, enabled estimation of charging and discharging times for PCM (the time has to be less than 24 hours). It also aided in validating the transient computer models and enabled development of a special thermal ramp procedure for testing of wall assemblies containing PCMs.

A nominal 2×4 wood frame wall insulated with novel dynamic reflective insulation (DRI) containing PCM-enhanced open-cell polyurethane foam was evaluated. In total, the DRI contained about 0.1 lb of PCM per ft² (0.49 kg/m²) of the surface area. The melting point of this PCM is 78°F (25.5°C), and the heat of fusion is about 60 Btu/lb (140 J/g). This wall had six identical cavities (2×4 wood studs were installed at 16-in. on center [o.c.], and the cavities were insulated with unfaced R-13 fiberglass batts). In three of these cavities, a novel batt insulation facing (DRI) was installed as shown in Figure 1. All cavities were inclosed with ½-in. thick (1.3-cm.) oriented strand board sheathing on one side and ½-in. thick (1.3-cm.) gypsum board on the second side.

During dynamic hot-box testing, side-by-side thermal performance was compared for two wall options:

1. Three conventional 2×4 wall cavities insulated with R-13 fiberglass batts
2. Three 2×4 wall cavities insulated with R-13 fiberglass batts and DRI containing PCM-enhanced foam. This part of the wall surface area, 32 ft² (6 m²), had a total heat storage capacity of about 192 Btu (202.6 KJ).

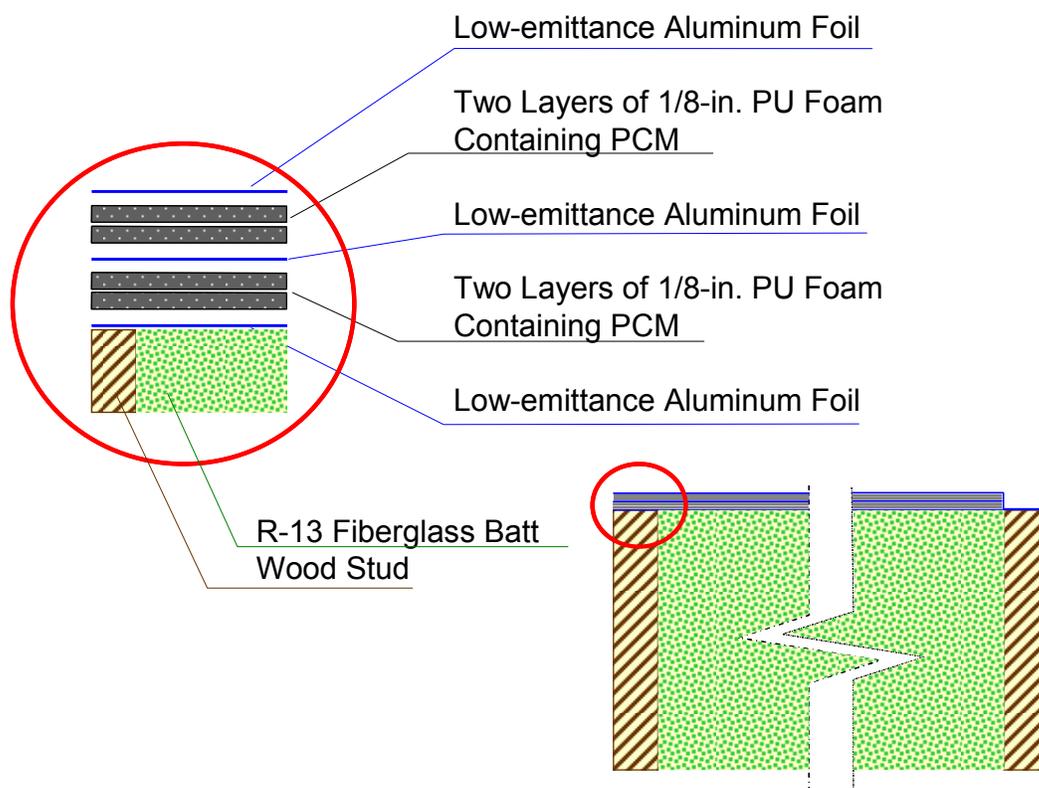


Figure 1. Schematic of Dynamic Radiant Insulation (DRI) Containing PCM-Enhanced Foam.

Dynamic hot-box testing was initiated with about 60 h of steady-state heat flow in the wall and a temperature difference across the test specimen of 47°F. Next, the temperature on the cold side was increased to 66°F and the temperature of the warm side was slightly increased to 78°F. After the assembly reached steady-state heat transfer condition, a rapid temperature increase to 95 °F was programmed on the warm side of the wall. Next, after almost 80 h, the hot-box heaters were turned down and the temperature of the warm side of the wall was reduced by natural cooling to 68°F. Table 1 shows the temperatures used for the dynamic hot-box test.

Table 1. Temperature profiles of the dynamic hot-box test of the wood frame test wall containing DRI and traditional fiberglass batt insulation

	Initial steady-state period	Ramp on the cold side	Rapid warm-up ramp	Cool-down ramp
Warm side	73°F (23°C)	78°F (26°C)	95°F (35°C)	68°F (20°C)
Cold side	20°F (-6.6°C)	66°F (19°C)	68°F (20°C)	66°F (19°C)

A side-by-side thermal performance comparison of the PCM wall containing DRI and a traditional 2×4 wood frame wall demonstrated a potential for steady-state and dynamic energy savings resulting from application of a multilayer dynamically working batt facing containing PCM-enhanced foam and low-emittance surfaces.

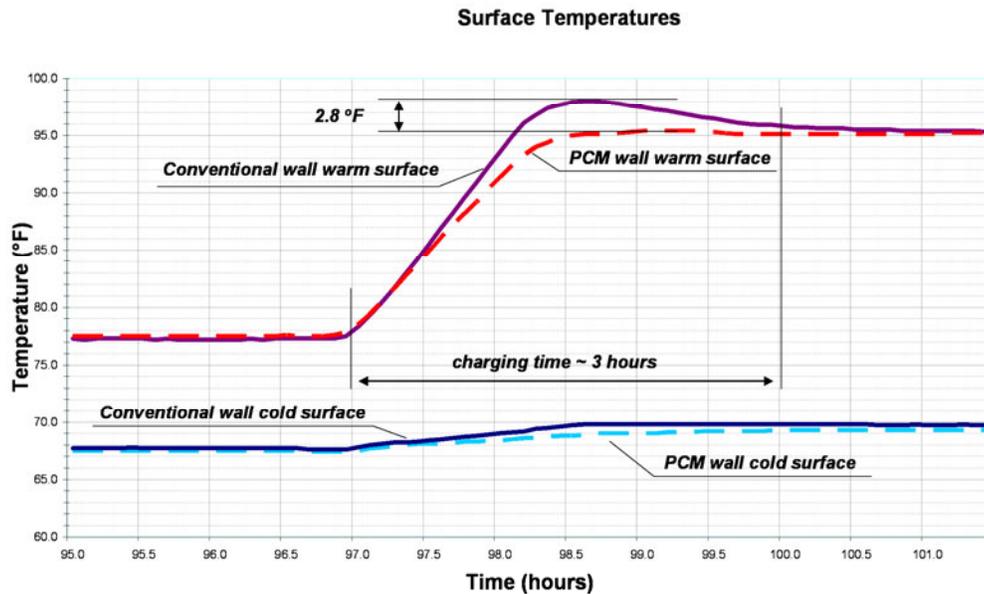


Figure 2. Surface Temperatures During Dynamic Hot-box Test of the PCM Wall containing DRI

As shown in Figure 2, it took about 3 h to fully charge the PCM in the test wall after a 17°F (22.8°C) thermal ramp. Analysis of the wall surface temperatures showed that the PCM demonstrated significant cooling and temperature stabilizing potential—there was a difference of almost 3°F (1.6°C) between the conventional and the PCM wall on the side of the thermal excitation. Since the PCM wall warmed much more slowly than the conventional wall (cooling effect), the temperature difference between the hot-box meter-side air and the surface of the PCM wall was higher than the conventional wall. Therefore, the heat flux on the warm side of the PCM wall was significantly higher as well. This difference in heat fluxes is shown in Figure 3 as “Cooling potential of the PCM wall.”

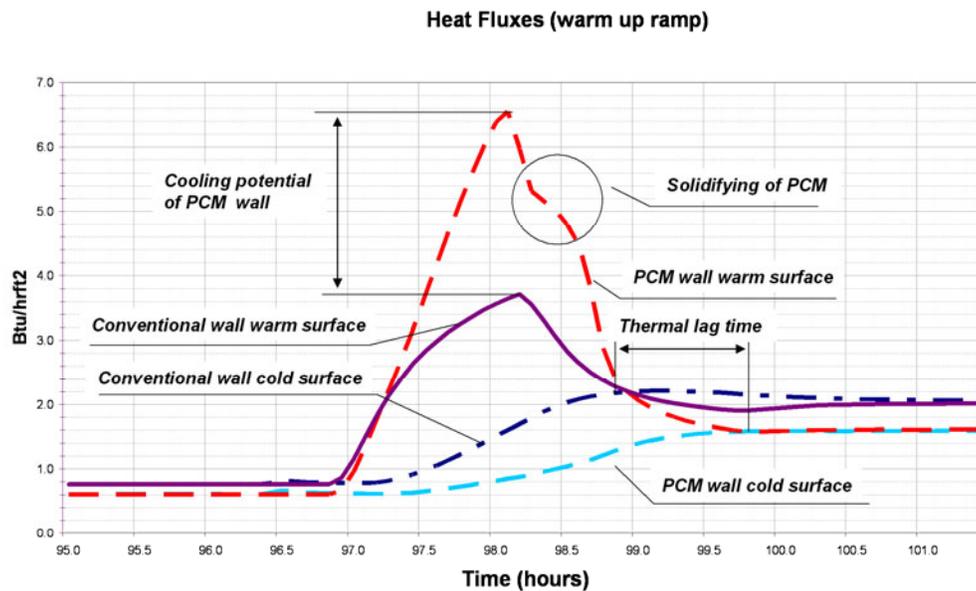


Figure 3. Heat Fluxes During the Thermal Excitation of the PCM Wall containing DRI

Comparisons of heat fluxes measured on the cold side of the wall during the time just after the thermal excitation (heat fluxes were integrated over the time) demonstrated a difference of about 40%. This value translates directly to a potential 40% reduction in the wall-generated peak-hour cooling load. A thermal lag time of about 1 h can also be observed on the cold surface of the PCM wall. For the same wall configuration, the discharge time for the PCM during the cool-down ramp was about 12 h.

Measurements of heat fluxes during periods of time with a steady-state heat flow enabled comparisons of the R-values of both parts of the test wall. Since the heat flux differences were over 20%, the R-value difference was between R-3 and R-4. This difference in R-value has to be attributed to the additional thermal resistance provided by the DRI.

FIELD TESTING OF CONCENTRATED PCM THERMAL MASS COMPONENTS IN RESIDENTIAL ATTICS AND WALLS

A prototype residential roof using a cool-roof surface, natural subventing, and DRI containing a PCM was designed and field tested. The test specimen was a multilayer configuration of PCM-enhanced polyurethane foams, PCM-impregnated fabrics, and highly reflective aluminum foil as shown in Figure 4. The loading of PCM was about 0.08 lb per ft² of the surface area (0.39 kg/m²). Two types of PCMs were used. Their melting temperatures were around 78 and 90°F (26 and 32°C). The total storage capacity of the DRI was about 4.8 Btu per ft² (54 kJ/m²) of the roof area.

The tested PCM roof used 4 in. (10-cm.) air channels to exhaust excess heat during peak irradiance (subventing). Two low-emittance membranes were placed above the roof sheathing boards with the low-emittance surfaces facing each other across the 4 in. air gap (description is greatly simplified). PCM storage was placed above the roof deck but below the reflective foil. Standing seam cool-painted metal roofing was used for this test assembly. Thus the thermal performance of this roof assembly represents the combined effects of reduced thermal bridging, reflective insulation, cool-roof pigments, PCM, and above sheathing ventilation.



Figure 4. Residential Attic Containing Dynamic Reflective Insulation

An assembly of three steep-slope attics with shed-type roofs was constructed for a side-by-side field test performance comparison between novel metal roof assemblies and a conventional asphalt shingle roof. Two standing seam metal roofs used cool-roof pigments, reflective insulation, and natural subventing channels. One of the metal roof assemblies also contained DRI with PCM. All test modules had ridge and soffit vents for ventilating the attic; the vent opening to the attic floor area was 1 to 300.

The conventional asphalt shingle roof had solar reflectance of 0.093 and thermal emittance of 0.89. A metal roof (standing seam metal with solar reflectance of 0.28 and thermal emittance of 0.81) was used for installation of the DRI and subventing air channels. Examples of the roof heat fluxes are presented in Figure 5 for two sunny summer days in 2006. During these days, for the asphalt shingle roof, the peak attic air temperature was close to 110°F (43.3°C) and roof surface temperature was about 160°F (71.1°C) (during peak hours). In comparison, the attic air peak temperature was only around 90°F (32.2°C) for the roof containing DRI and subventing channels.

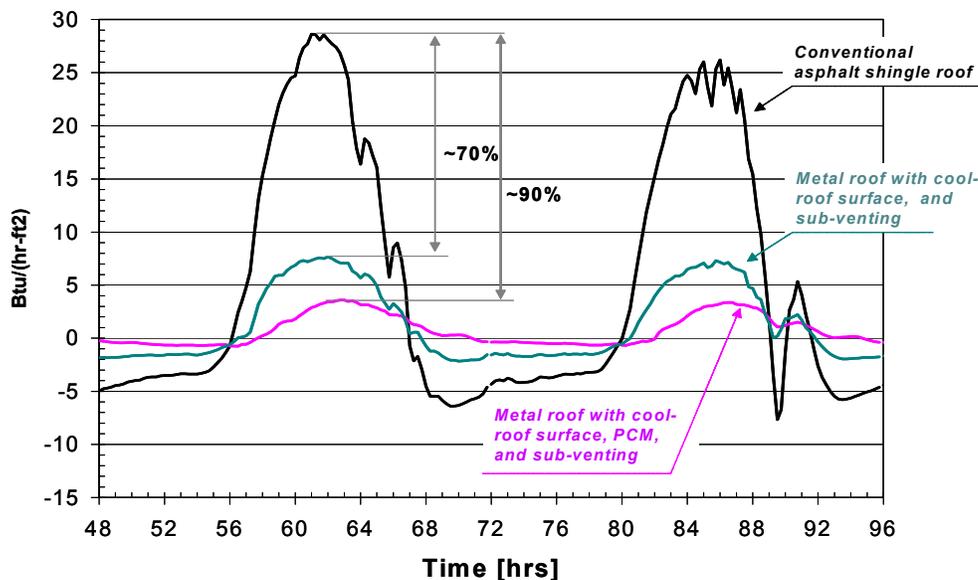


Figure 5. Experimental heat transfer penetrating the roofs of a direct nailed asphalt shingle, standing seam metal roof (containing, cool roof pigments, reflective insulation, and air channels), and similar metal roof containing Dynamic Reflective Insulation with PCM.

As shown in Figure 5, the conventional asphalt shingle roof had a heat flux of about 30 Btu/h·ft² (94.6 W/m²) penetrating the roof deck during peak solar irradiance. At the same time, on the metal roof with cool-roof pigments, reflective insulation, and air channels, the heat flux was about 8 Btu/h·ft² (25 W/m²). On a similar roof containing PCM, the heat flux was less than 4 Btu/h·ft² (12.6 W/m²). The results show that for the metal roof assembly using cool-roof pigments, reflective insulation, and subventing air channels, the summertime peak heat flow crossing the roof deck was reduced by about 70% compared with the heat flow penetrating the conventional shingle roof. Installation of the DIR containing the PCM generated an additional 20% reduction in the peak-hour heat flow, bringing the total reduction to 90%! Additionally, the PCM energy storage eliminated the overnight subcooling effect. This finding is important for applications of cool roofs in northern areas of the United States, where overnight subcooling compromises the energy performance of cool roofs.

During summer 2007, a similar configuration of the PCM-enhanced reflective insulation was installed on the test wall shown in Figure 6. In this field experiment, dynamic insulation containing PCM was compared against the conventional foam sheathing of the same R-value.



Figure 6. Experimental wall containing PCM-enhanced reflective insulation.

During the summer 2007 tested wall performed very well reducing (in average) peak hour heat flow by about 60%. Peak load was also shifted about 8 hours. It was observed that, in the middle of a sunny day, thanks to PCM-enhanced dynamic insulation and air ventilation cavity, exterior surface temperature of the concrete blocks behind was almost the same as on interior wall surface as shown on Figure 7. At the same time, similar temperature of the wall containing conventional foam sheathing insulation was about 6 to 10 degrees higher.

The heat flow reduction demonstrated in these experiments is very dramatic, and the results are leading researchers toward development and validation of a new generation of energy-efficient roof and wall systems that support zero-energy building initiatives.

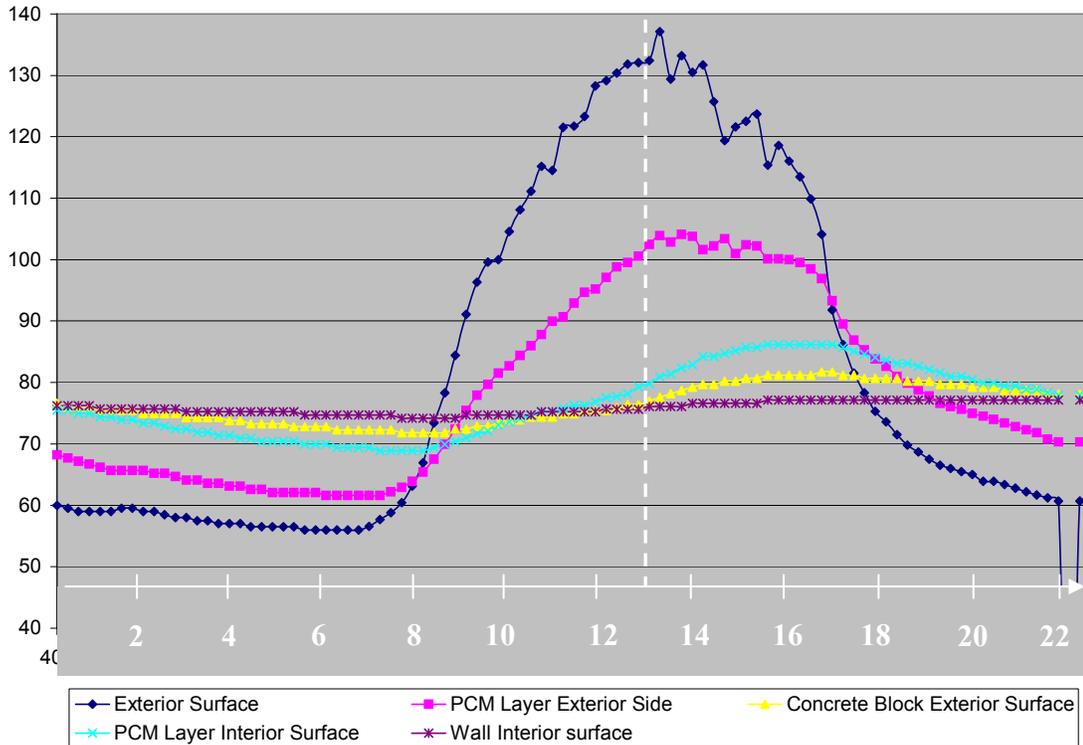


Figure 7. Temperature Profiles in the Test Wall containing PCM-Enhanced Reflective Insulation

TESTING OF WOOD FRAME WALLS AND ATTICS CONTAINING DISPERSED PCM

During 2002-04 PCM-enhanced fiber insulations were developed to generate a thermal mass effects in building envelope. Small amounts of different cellulose-PCM blends were produced with the use of a pilot-scale production line (Kosny 2006). In this project, microencapsulated paraffinic PCM was used. The PCM microcapsules were between 2 and 20 micrometers in diameter, and their melting point was 78.5°F. This PCM is produced with the use of a new microencapsulation technology that holds wax droplets inside hard acrylic polymer shells. Since production of cellulose insulation already includes the addition of dry chemicals, the addition of a dry PCM component does not require significant changes in the manufacturing or packaging processes.

A series of steady-state heat flow apparatus thermal conductivity measurements were conducted on the 2 in. (5 cm.) thick samples of PCM-enhanced cellulose insulation. These tests showed that the addition of up to 30% of the microencapsulated PCM does not increase the thermal conductivity of the cellulose insulation (Kosny 2006).

A nominal 8×8 ft (2.4×2.4 m) wood-frame wall specimen was used for transient hot-box testing of a PCM-cellulose blend. The test wall was constructed with 2×6 in. (6×15.2 cm) wood framing installed 16-in. o.c. (40 cm). Three wall cavities were insulated with plain cellulose of a density about 2.6 lb/ft³ (42 kg/m³). Three remaining wall cavities were insulated with a cellulose-PCM blend of a density of about 2.6 lb/ft³ (42 kg/m³) and containing about 22% by weight of PCM. It is estimated that about 38 lb (17 kg) of PCM-enhanced cellulose insulation (containing 8 lb or 3.6 kg of PCM) was used for this dynamic experiment.

At the beginning of the hot-box measurement, temperatures on both surfaces of the specimen were stabilized at about 65°F (18.3°C) on the cold side and 72°F (22.2°C) on the warm side. Next, the temperature of the warm side was rapidly increased to 110°F (43.3°C). Next, after about 120 h, the hot-box heaters were turned down and the temperature of the warm side of the wall was reduced by natural cooling

to 65°F (18.3°C). Figure 8 depicts test-generated heat fluxes for both parts of the wall, recorded during the rapid warm-up excitation.

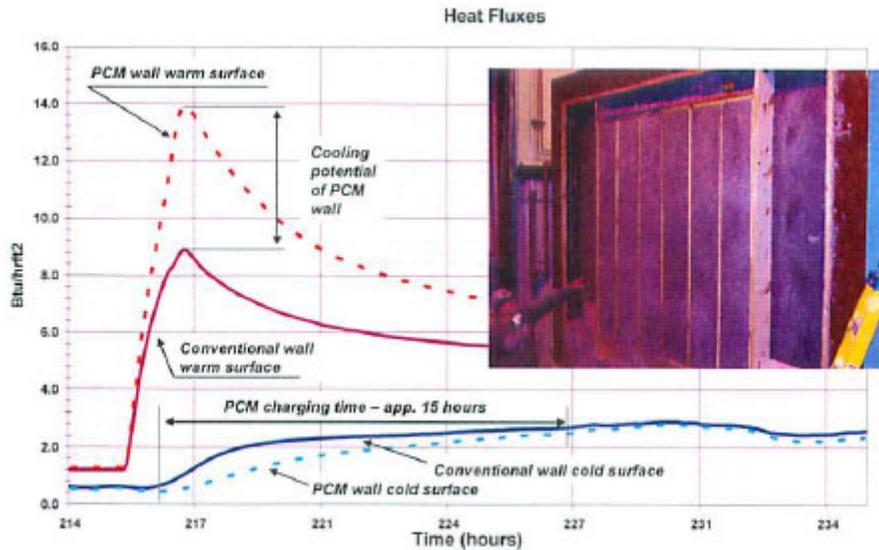


FIGURE 8. Heat flux measured during the dynamic hot-box experiment performed on the 2x6 wood stud wall containing PCM-enhanced cellulose insulation.

It took 15 h to charge the PCM material within the wall. Heat fluxes on both sides of the wall were measured and compared. For three 5-hour time intervals, heat fluxes were integrated for each surface. Comparisons of measured heat flow rates on the wall surface, which was opposite the thermal excitation, enabled an estimate of the potential thermal load reduction generated by the PCM. In reality, most daily thermal excitations generated by solar irradiance are no longer than 5 h (peak-hour time). Heat flux was measured during the first 5 h after the thermal ramp. The PCM-enhanced cellulose material reduced the total heat flow through the wall by over 40%. The load reduction for the entire 15 h of the PCM charging time was close to 20%. Surface temperatures on the PCM part of the test wall specimen were approximately 2°F (1°C) lower during the time of the thermal ramp (cooling effect).

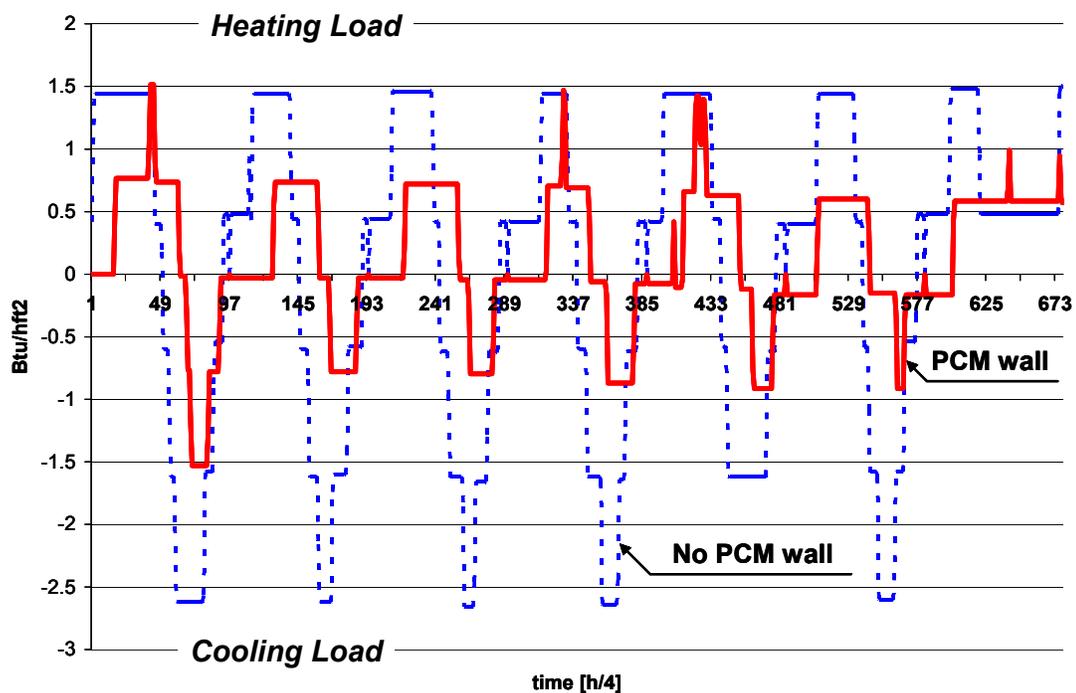


Figure 9. Comparison of surface heat fluxes recorded during field experiment which took place during a sunny week in April 2006.

Two small-scale field tests were performed on 2×6 in. (6×15.2 cm) wood frame walls insulated with PCM-enhanced cellulose insulation. Test walls were installed in Oak Ridge, Tennessee, and in Charleston, South Carolina. In both cases, PCM walls were constructed next to identical wood stud walls containing cellulose insulation with no PCM. To estimate the effect of direct solar radiation, the walls tested in Oak Ridge faced south and the walls tested in Charleston faced northwest.

Figure 9 shows heat fluxes recorded in Tennessee on test walls during a sunny week in late April 2006. Exterior surface temperatures on the Oak Ridge walls were cycling between 120°F (49°C) during the days and 55°F (12.7°C) during most nights. Field test data demonstrated that the PCM wall was more thermally stable than the conventional wall. Significantly lower heat fluxes were observed in the PCM wall: peak-hour heat flux was reduced by at least 30% compared with the conventional wall without PCM. In addition, a shift of about 2 h in the peak-hour load was observed in the PCM wall.

Analysis of the temperature profiles in the tested walls showed that the PCM was going through full charging and discharging processes during the 24-h time period. Recorded temperature profiles presented in Figure 10 demonstrate clearly that the PCM thermally stabilized the core of the wall as a result of its heat storage capacity. Temperature peaks were notably shifted inside the PCM wall. Significantly lower temperatures were observed during the night in the wall cavities where no PCM was used. The conventional wall (with no PCM) was warming up and cooling down significantly more quickly than the PCM wall.

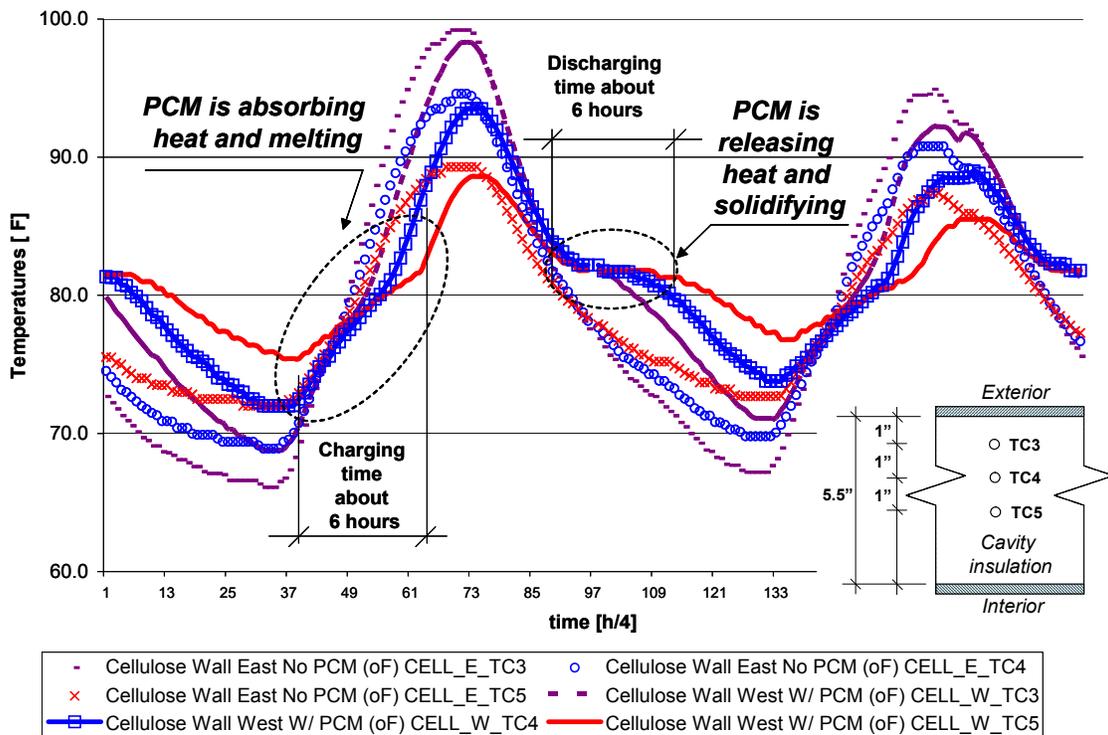


FIGURE 10. Example of temperature profiles recorded inside the wall cavities of the south-facing test walls (no-PCM wall located on the east side, PCM wall located on the west side), during the sunny week of late April 2006 in Oak Ridge, TN.

Dynamic hot-box experiments were performed on a residential attic module. The attic module was tested under periodic temperature changes in the Large Scale Climate Simulator (LSCS) at the Oak Ridge National Laboratory. Two concentrations of microencapsulated PCM were tested (5% and 20% by weight). The main focus of the attic tests was discharging time of the PCM, since dynamic hot-box testing of the wall had already proved the good thermal performance of the PCM-enhanced cellulose insulation. Charging is not a problem in attics because of the intensive fluctuations of the attic air temperature during sunny days (a rapid increase in temperature caused by the sun). However, the attic cooling process is significantly slower. In a well-designed PCM application, 100% of the PCM material should be able to fully discharge its energy before daytime operation the next day.

During the dynamic LSCS tests, the model of the residential attic was subjected to periodic changes of temperature (65°F [18°C] for about 16 h, rapid temperature ramp to 120°F [49°C] and exposure to 120° F

for about 4 h, followed by natural cooling back to 65°F). The array of thermocouples installed at 1 in. (2.5 cm) intervals was used to monitor temperature distribution across the attic insulation. One of the interesting findings from the analysis of temperature fields was that only layers of insulation located higher than 4 in. (10 cm) from the bottom of the attic were involved in the phase change process. It took about 6 to 8 h to fully discharge the energy stored in these layers. No additional fans providing forced ventilation were needed to discharge the PCM. This finding will have to be confirmed in the future under full-scale whole-house field conditions. It is interesting that analysis of the temperature profiles demonstrated visual evidence of charging and discharging of PCM (similar to those presented in Figure 10 for PCM wall) even in attic insulation containing only 5% PCM. Because of the limited space in this paper, this complex attic test experiment will be described in more detail in other future publications.

CONCLUSIONS

During 2003–2006, several new applications of PCM-enhanced building envelope materials were tested and analyzed. In contrast to historical PCM studies, these studies showed that concentrated PCM does not have to be directly exposed to the building interior. Two forms of PCM application were considered: dispersed PCM application in cellulose insulation, and concentrated application with batt fiber insulations or as a part of a novel attic insulation system. The following conclusions can be derived from this research work:

1. Hot-box test demonstrated that DRI (dynamic reflective insulation containing PCM), installed in wood frame walls, can effectively reduce heat flow generated by dynamic thermal excitations.
2. In a field-tested residential attic with a cool-painted metal roof using reflective insulations and subventing air channels, summertime peak heat flow crossing the roof deck was reduced by about 70% compared with the heat flow penetrating a conventional shingle roof.
3. In a similar cool-roof attic containing DRI (with PCM), an additional 20% reduction of the peak-hour heat flow was observed.
4. In a tested prototype attic design, the total summertime peak heat flow crossing the roof deck was reduced by about 90% compared with the heat flow penetrating a conventional shingle roof.
5. In the prototype attic, the PCM energy storage eliminated the overnight subcooling effect.
6. A dynamic hot-box test that included a 40°F (20°C) thermal ramp, performed on a 2×6 wood frame wall, demonstrated about 40% reduction of the surface heat flow as a result of the use of PCM. This finding was confirmed by the field tests.
7. A dynamic hot-box test performed on the attic containing PCM-enhanced cellulose insulation proved that PCM can be fully discharged without the use of additional forced ventilation of the attic. This finding has to be confirmed under full-scale field conditions.

REFERENCES

- Balcomb, J.D., R.W. Jones, C.E. Kosiewicz, G.S. Lazarus, R.D. McFarland, W.O. Wray. 1983. *Passive Solar Design Handbook*. ISBN 0-89553-124-0. American Solar Energy Society, Inc.
- Feustel, H. E. 1995. *Simplified Numerical Description of Latent Storage Characteristics for Phase Change Wallboard*. Indoor Environmental Program, Energy and Environment Division. Lawrence Berkely Laboratory. University of California.
- Salyer, I., and A. Sircar. 1989. "Development of PCM wallboard for heating and cooling of residential buildings." Thermal Energy Storage Research Activities Review. U.S. Department of Energy, New Orleans, March 15–17.

- Tomlinson, J., C. Jotshi, and D. Goswami. 1992. "Solar thermal energy storage in phase change materials." *Proceedings of Solar '92: The American Solar Energy Society Annual Conference*, Cocoa Beach, FL, June 15–18.
- Kissock, J. Kelly, J. Michael Hannig, Thomas I. 1998. "Testing and simulation of phase change wallboard for thermal storage in buildings." *Proceedings of 1998 International Solar Energy Conference*, Albuquerque, June 14–17. J.M. Morehouse and R.E.Hogan, Eds. American Society of Mechanical Engineers.
- Kosny, J., D. Gawin, and A. Desjarlais. 2001. "Energy benefits of application of massive walls in residential buildings." *DOE, ASHRAE, ORNL Conference—Thermal Envelopes VIII*, Clear Water, Florida, December 2001.
- Kosny J., Yarbrough D., Wilkes K., Leuthold D., Syad A. 2006. "PCM-Enhanced Cellulose Insulation – Thermal Mass in Lightweight Natural Fibers" 2006 ECOSTOCK Conference, IEA, DOE, Richard Stockton College of New Jersey, June 2006.
- Kossecka E., Kosny, J. 2001. "Influence of Insulation Configuration on Heating and Cooling Loads in a Continuously Used Building." *DOE, ASHRAE, ORNL Conference—Thermal Envelopes VIII*, Clear Water, Florida, December 2001.
- Zhang, Meng, M.A. Medina, and Jennifer King. 2005. "Development of a thermally enhanced frame wall with phase-change materials for on-peak air conditioning demand reduction and energy savings in residential buildings." *International Journal of Energy Research*. 29(9):795–809.